
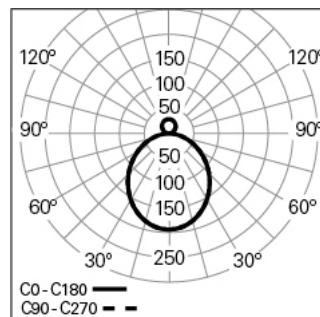


**CONCEPT O 65 D/I D0900 LIGHT+ DALI K3 830 7**

ARCHITECTURAL LIGHTING

**90636L900H73300****Light distribution****PRODUCT DESCRIPTION**

**Application Areas:** Architectural, Offices, Hotels and residential, Public spaces, Retail, Art and Culture, Education, Health and care

**Mounting Type:** Suspended

**Control Gear Included:** Yes

**Control Gear:** LED driver 220-240VAC-50/60Hz

**CONCEPT O 65 D/I D0900 LIGHT+ DALI K3 830 7****CHARACTERISTICS**

**Luminaire Type:** Circular luminaire

**Luminaire Module:** Individual

**Insulation Class:** I

**Ingress Protection (IP):** 20

**Ambient Temperature Range (°C):** ]5, 25[

**Warranty (Years):** 5

**Current Supply Cable Entry Point:** Back

**MATERIALS**

**Body Material:** Extruded aluminium profile

**Finishing:** Epoxy polyester powder coated

**Colour:** Copper (7)

**Glow-wire Resistance (°C):** 650

**OPTICAL SYSTEM**

**Optical System:** LIGHT+ - Opal diffuser

**Light Distribution:** Direct / Indirect

**Beam Angle (°):** 103

**TECHNICAL DATA**

**Light Source:** LED

**Input Power (W):** 67

**Input Driver Voltage:** 220-240V-50/60Hz

**Power Factor (λ):** 0,98

**Luminaire Luminous Flux (lm):** 6698

**Luminaire Efficacy (lm/W):** 100

**Emergency Unit:** 3

**LED Lifetime - Rated Median Useful Life:** 80.000h @ L90, B10, Ta 25°C

**CCT - Correlated Colour Temperature (K):** 3000

**Colour Rendering Index (CRI):** >80

**Chromaticity Tolerance (MacAdam step):** <3

**LED Module Forward Voltage Range (VF):** 2,7

**Power Supply Dimming:** DALI 2

**Maximum of Luminaires by Magnetic Circuit Breaker B16:** <15

**Inrush Current (A):** 41

**Pulse Duration (µs):** 187

**DIMENSIONS**

**W - Width (mm):** 65

**H - Height (mm):** 85

**D - Diameter (mm):** 900

**Net Weight (kg):** 0.344

**NOTES**

- To complete the product it is necessary to order the suspension, the current supply cable and ceiling rose. Please order separately;
- In order to guarantee a total uniformity of light on the ceiling, the installation must be done at a minimum distance of 500 mm.